

Issue Date: 05-30-2018
Revision Date: 08-26-2026
Renewal Date: 05-31-2027

DIVISION: 07 00 00 – THERMAL AND MOISTURE
Section: 07 46 33 – Plastic Siding

REPORT HOLDER:

Resysta North America, Inc.
14350 SW 142 Avenue
Miami, FL 33186
909-590-0121
www.resystausa.com

REPORT SUBJECT:

Resysta 6" Siding

- **RESCP120612**
- **RESCPH120612**

1.0 SCOPE OF EVALUATION

1.1 This Research Report addresses compliance with the following Codes:

- 2024, 2021, 2018 *International Building Code*® (IBC)
- 2024, 2021, 2018 *International Residential Code*® (IRC)
- 2023, 2020 *Florida Building Code* (FBC) (see Section 9), Including HVHZ
- 2025, 2022 *California Building Code* (CBC) excluding Exterior Wildfire Exposure (see Section 9)

NOTE: This report references the most recent Code editions cited. Sections numbers in earlier versions of the codes may differ.

1.2 *Resysta Siding* has been evaluated for the following properties:

- Durability
- Surface Burning
- Weather Resistance
- Wind Load Resistance
- Decay Resistance
- Termite Resistance

1.3 The *Resysta Siding* is intended for use as an exterior wall covering on buildings of Type VB construction (IBC, FBC, CBC) and all construction types permitted under the IRC.

2.0 STATEMENT OF COMPLIANCE

Resysta Siding complies with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.

2.1 2024 IBC and IRC Evaluation Reports

The Intertek CCRR is an *Evaluation Report* for approval of an alternate material, design, or method of construction in accordance with Section 104.2.3.6.1 of the 2024 IBC and Section R104.2.2.6.1 of the 2024 IRC.

3.0 DESCRIPTION

3.1 *Resysta 6" Siding* is a mono-extruded, rigid plastic composite siding consisting of polyvinyl chloride and rice hull filler. *Resysta 6" Siding* is finished with a simulated wood-grain pattern and has an exposure width of 6 inches. See Figure 1.

4.0 PERFORMANCE CHARACTERISTICS

4.1 Windload Resistance – Maximum allowable negative design pressures are shown in Table 2 for the *Resysta 6" Siding* when installed in accordance with this report.

4.1.1 *Resysta 6" Siding* has not been evaluated for resisting positive wind pressure. Siding must be installed over structural wood sheathing designed to resist positive design wind pressures in accordance with the applicable code.

4.2 Materials are deemed equivalent to preservative treated or naturally durable wood for resistance to weathering effects, attack from termites and fungus decay.



4.3 Materials used have a flame spread index of less than 200 when tested in accordance with ASTM E 84.

4.4 *Resysta 6"* Siding complies with Section 2605.2 of the IBC for use as an exterior plastic veneer.

5.0 INSTALLATION

5.1 *Resysta 6"* Siding must be installed in accordance with the manufacturer's published installation instructions, the applicable Code and this Research Report. The manufacturer's published installation instructions and this Research Report must be strictly adhered to, and a copy of the instructions must be available on the jobsite during installation. See Table 2 for fastening schedule.

5.2 *Resysta 6"* Siding shall be installed via steel, aluminum, or wood battens over an approved structural wood sheathing; 5/8-inch plywood complying with DOC PS 1, DOC PS 2, or ANSI/APA PRP 210, per IBC 2303.1.5.

5.3 Sheathing must be covered by an approved water-resistive barrier complying with IBC Section 1403.2, and Section R703.1.1 of the IRC, and provide a means for draining water that enters the assembly to the exterior.

5.4 Protection against condensation shall be provided in accordance with IBC Section 1404.3.

5.5 Flashing shall be installed in accordance with IBC Section 1404.4 [1405.4], and IRC Section R703.4.

6.0 CONDITIONS OF USE

6.1 Installation must comply with this Research Report, the manufacturer's published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

6.2 Wind design pressures determined from nominal design wind speeds (V_{asd}) in accordance with Section 1609.3.1 of the IBC shall not exceed the maximum allowable design pressure given in Table 2 for *Resysta 6"* Siding.

6.3 *Resysta 6"* Siding is limited to exterior use on buildings of combustible nonfire-resistance-rated construction: IBC Type V-B construction and all construction types permitted under the IRC.

6.4 Only those types of fasteners and fastening methods described in this report have been evaluated for the installation of the *Resysta 6"* Siding. Other methods of attachment are outside the scope of this report.

6.5 The battens and batten attachment to the building structure is outside the scope of this report.

6.6 All products are manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc.

7.0 SUPPORTING EVIDENCE

7.1 Manufacturer's drawings and installation instructions.

7.2 Reports of testing demonstrating equivalent impact and windload resistance requirements for plastic siding in accordance with ASTM D7254-21 [17], Standard Specification for polypropylene (PP) siding.

7.3 Reports of testing demonstrating termite and decay resistance in accordance with ASTM D7032-21 [17], Standard Specification for Establishing Performance Ratings for Wood-Plastic Composite Deck Boards and Guardrail Systems (Guards or Handrails) as required by IBC Section 2612.4 for Plastic Composites.

7.4 Reports of testing demonstrating compliance with ASTM E84-21a [18B], Test Method for Surface Burning Characteristics of Building Materials.

7.5 Reports of freeze-thaw, water and weathering resistance demonstrating compliance with ICC-ES AC92, Acceptance Criteria for Polymer-based, Polymer-modified and High-Pressure Laminate Exterior and Interior Wall Cladding, approved December 2013, editorially revised March 2016.

7.6 Reports of testing in accordance with ASTM D1929-20 [16], Test Method for Determining Ignition Properties of Plastics.

7.7 Reports of testing in accordance with ASTM D2843-22 [16], Test Method for Density of Smoke from the Burning or Decomposition of Plastics.





7.8 Reports of testing in accordance with ASTM D635-18 [16], Test Method for Rate of Burning and/or Extent and Time of Burning of Self-supporting Plastics in a Horizontal Position.

7.9 Reports of evaluation and engineering analysis for allowable fastener design capacities by a Professional Engineer registered in the State of Florida.

7.10 Testing for Florida Building Code was performed by a Miami-Dade County approved testing facility (Architectural Testing, Inc. – York, PA) with reports signed and sealed by a Professional Engineer registered in the State of Florida. These reports are;

7.10.1 Reports of testing demonstrating compliance with Section 2615.2 of the Florida Building Code for Approved Plastics.

7.10.2 Reports of testing to Testing Application Standard (TAS) 202-94 "Criteria for Testing Impact & Nonimpact Resistant Building Envelope Components Using Uniform Static Air Pressure" as required by Section 1620 of the Florida Building Code.

7.10.3 Reports of testing to Testing Application Standard (TAS) 203-94 "Criteria for Testing Products subject to Cyclic Wind Pressure Loading" as required by Sections 1625, Table 1625.4 and Table 1626 of the Florida Building Code.

7.11 Documentation of an Intertek approved quality control system for the manufacturing of products recognized in this report.

8.0 IDENTIFICATION

The *Resysta* 6" Siding is identified with the manufacturer's name (*Resysta*), the Intertek Mark, and the Code Compliance Research Report number (CCRR-0272).



9.0 OTHER CODES

9.1 FLORIDA BUILDING CODE

9.1.1 Scope of Evaluation:

The *Resysta* 6" Siding was evaluated for compliance with the *Florida Building Code – Building* and *Florida Building Code – Residential*.

9.1.2 FBC, High Velocity Hurricane Zones (HVHZ) - *Resysta* 6" Siding has been additionally tested to show compliance with the requirements of the Florida Building Code for use in locations designated as High Velocity Hurricane Zones. Testing has shown;

9.1.3 Sufficient weathering resistance of plastics with outdoor exposure when tested to ASTM G 155 and ASTM D 2565 for a period of 4500 hours and subsequent testing demonstrating compliance with FBC Section 2615.2.

9.1.4 Sufficient resistance to wind forces as determined by Section 1620 of the Florida Building Code when tested to FBC Test Protocol TAS 202-94.

9.1.5 Sufficient resistance to cyclic wind pressure loading as determined by Sections 1625, Table 1625.4 and Table 1626 of the Florida Building Code when tested to FBC Test Protocol TAS 203-94.

9.1.6 Conclusion:

The *Resysta* 6" Siding, described in Sections 2.0 through 7.0 of this Research Report, comply with the *Florida Building Code – Building* and *Florida Building Code – Residential*, subject to the following conditions:

- Use of the *Resysta* 6" Siding for compliance with the High-Velocity Hurricane Zone provisions of the *Florida Building Code – Building* and the *Florida Building Code – Residential* has been evaluated and is within the scope of this Research Report.





9.2 CALIFORNIA BUILDING CODE

The *Resysta 6" Siding* described in Sections 2.0 through 7.0 of this Research Report, complies with the *California Building Code*, subject to the following conditions:

- Code requirements for Exterior Wildfire Exposure in Wildland-Urban Interface (WUI) areas have not been evaluated and are outside the scope of this Report.

10.0 CODE COMPLIANCE RESEARCH REPORT USE

10.1 Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

10.2 Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

10.3 Reference to the <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.

This Code Compliance Research Report ("Report") is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005
intertek.com/building





TABLE 1 – PROPERTIES EVALUATED

PROPERTY	APPLICABLE CODE SECTIONS ¹					
	IBC	IRC	FBC	FBC-R	CBC	CRC
Exterior Wall Performance Requirements	1402	R703.1	1403	R703.1	1402	R703.1
Materials	104.2.	R104.2.2 R104.11	104.11	R104.11	104.2.3	R104.11
Wind Load Resistance	1609	R703.1.2	1609	R703.1.2	1609	R703.1.2

¹Section numbers pertain to the most recent edition cited in Section 1.1 of this Report.

TABLE 2 – RESYSTA 6" SIDING ALLOWABLE DESIGN PRESSURES

Vertical Battens			Fastener ⁽²⁾		Allowable Design Pressure ⁽⁴⁾
Material ⁽¹⁾	Thickness ⁽¹⁾	Horizontal Spacing	Description	Spacing	
Spruce-Pine-Fir (Specific Gravity, 0.42)	3/4"	16"	#8 (0.164" dia.) x 1-1/2" bugle-head, stainless steel, wood screws	16" o.c.	100 psf
Structural Steel Grade 50	18 gauge	16"	#8 (0.164" dia.) x 3/4" bugle-head, stainless steel, TEK screws. ⁽³⁾	16" o.c.	126 psf
6063-T5 Aluminum	0.045"	16"	#8 (0.164" dia.) x 3/4" bugle-head, stainless steel, TEK screws. ⁽³⁾	16" o.c.	103 psf

⁽¹⁾ Installation on battens with a lesser thickness or lesser mechanical properties may result in a lower allowable design pressure.

⁽²⁾ Fasteners are installed through the center of the prefabricated slotted holes. Same fasteners are used to fasten the aluminum (6063-T5) starter strip to the battens. See Figure 2.

⁽³⁾ Fasteners for attachment to steel or aluminum battens shall extend through the steel or aluminum a minimum of three exposed threads.

⁽⁴⁾ Applicable to design pressures determined from allowable stress [nominal] design wind speeds (V_{asd}) in accordance with Section 1609.3.1 of the IBC, FBC, and CBC.



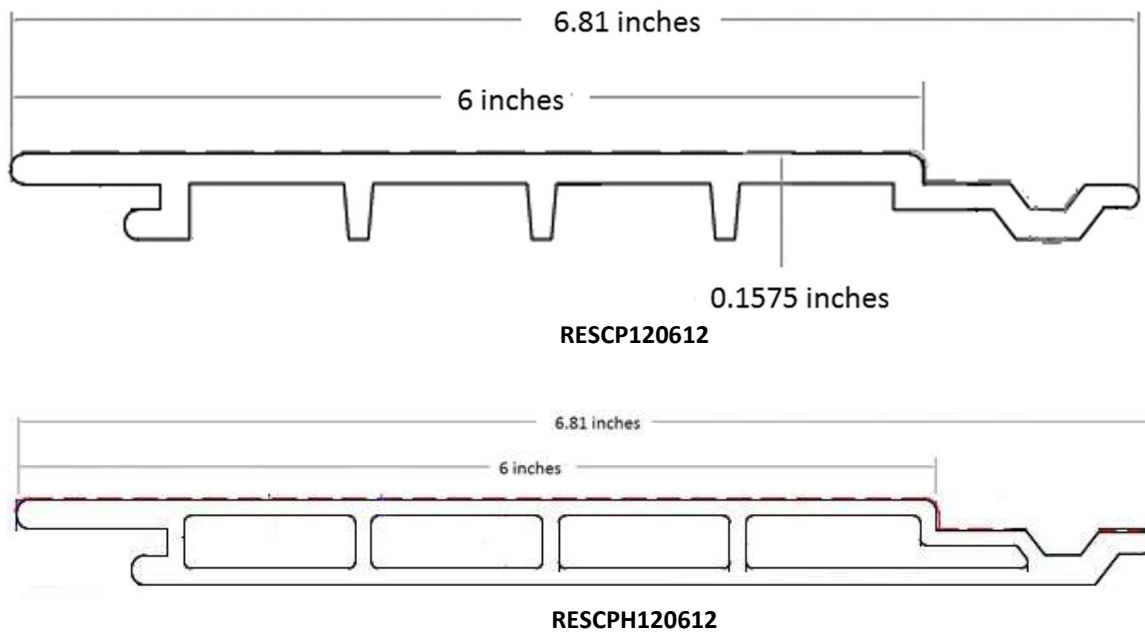


FIGURE 1 – RESYSTA 6" SIDING

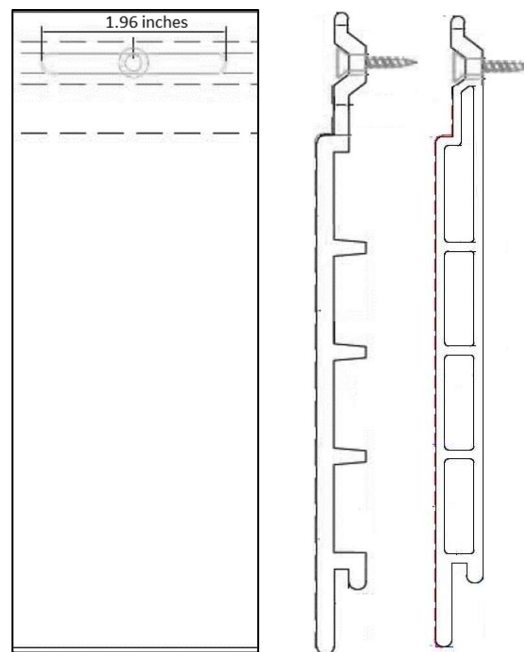


FIGURE 2 – INSTALLATION